

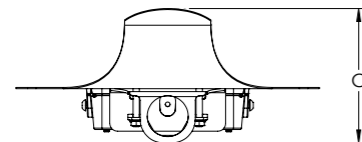
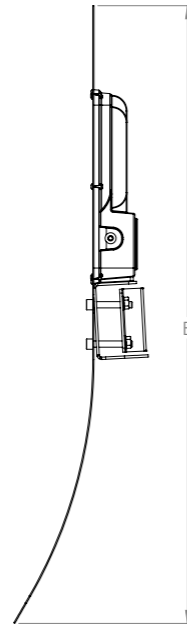


LPM-S Series Installation Way

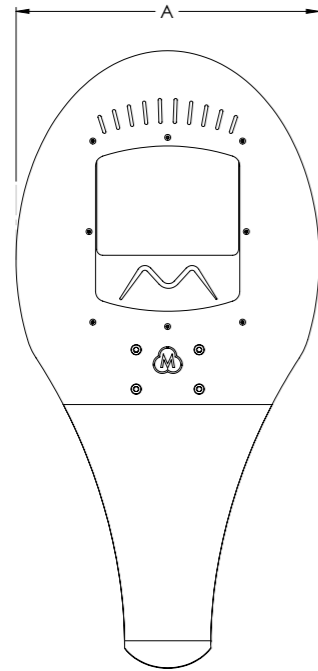

| A | B | C |
|--------|--------|--------|
| 385 mm | 785 mm | 170 mm |

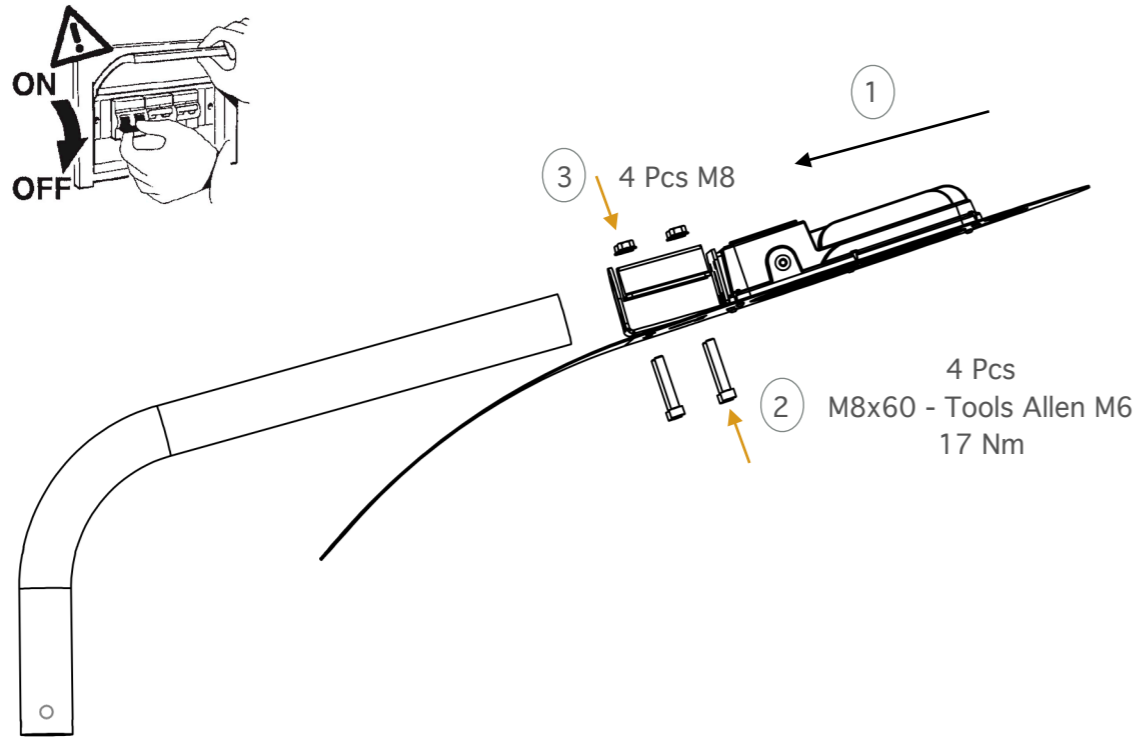

The lighting armature must be at the same voltage as the working voltage and the network voltage.

Make sure that the mains voltage is disconnected from the relevant panel before starting the armature connection.

Hang the signboards that work on the relevant panel and that the energy should not be turned on.

Mount the armature according to the torque levels on the side according to your pole.

Check the stability.



Make the klamens connections. Check the connection of the grounding line and make sure.

Make sure there is no additional connection cable.

Check the connection accuracy.

Give energy to the armature.

SECURITY INSTRUCTIONS

Take the necessary precautions during installation of high ceiling fixture. Please follow the rules of the regulation.

Comply with the Occupational Safety Regulations.

Make the armature Assembly an experienced electrician. Always disconnect the power before installation and maintenance. Use a soapy cloth to clean the armature. Do not clean with thinner, and similar products. Keep away from combustible materials.

Check the mains voltage before energizing. Make sure it is 220-240 AC 50-60 Hz. Check the frequency of the connection cables.